


MIXED BED DE-IONIZER (58-10 STAGER)

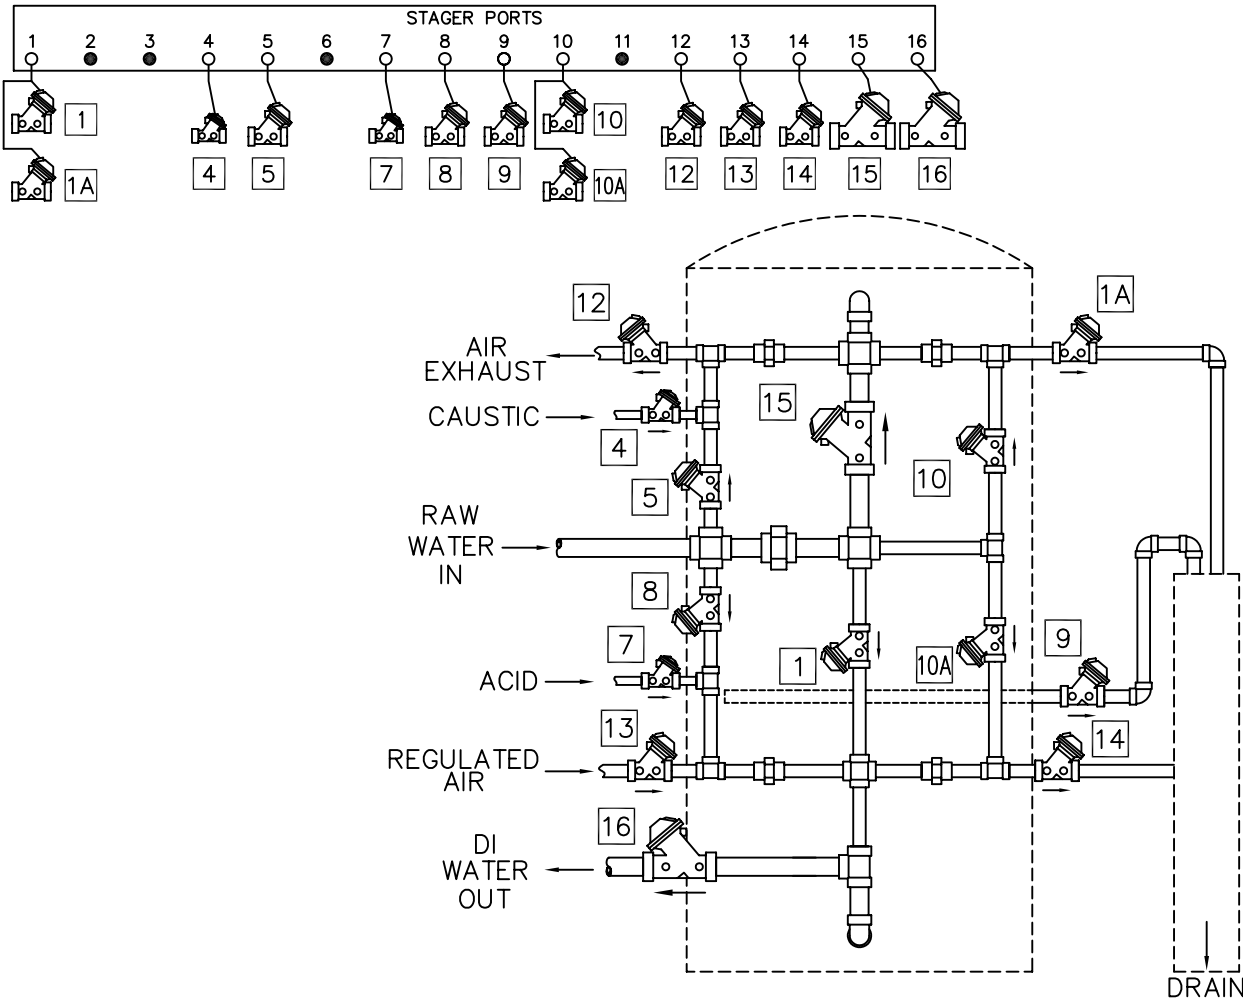

NOTE:

1. ALL OTHER PORTS PRESSURIZED.
2. ALL VALVES NORMALLY OPEN, PRESSURE TO CLOSE.

PRINTED IN U.S.A.

SERIES 58B-10 STAGER PROGRAM

NOTCH	POS.	FUNCTION	PORTS VENTED (NOTE 1)	VALVES OPEN	NOTCH	POS.	FUNCTION	PORTS VENTED (NOTE 1)	VALVES OPEN
A	0	SERVICE	15,16	15,16	J	5	ACID INJECT	7,8,9	7,8,9
B					K	6	SLOW RINSE	8,9	8,9
C	1	BACKWASH	1	1,1A	L	7	RINSE	9,10	9,10,10A
D	2	SETTLE	NONE	NONE	M				
E					N	8	DRAIN DOWN	9,12	9,12
F	3	CAUSTIC INJECT	4,5,9	4,5,9	P	9	AIR INJECT	12,13	12,13
G	4	SLOW RINSE	5,9	5,9	Q				
H					R	10	FINAL RINSE	14,15	14,15

REV	DESCRIPTION	ECO	MSM	DWN	DATE	APVD
A	INITIAL RELEASE	NONE	MSM		31JUL01	

	20580 Enterprise Avenue Brookfield, WI 53045 888.784.9065 www.Pentairwatertreatment.com		
	MIXED BED DE-IONIZER		
SCALE	DRAWN	DATE	DWG. NO.
N/A	JWB	31JUL01	1078292